



## LISTING INFORMATION OF Tenmat Firefly 109 Recessed Light Cover

SPEC ID: 29353

Tenmat, Incorporated  
23 Copper Drive, Unit #3  
Newport, DE 19804

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

The Firefly 109 is a shell constructed of a mineral fiber-matrix which has an intumescent property. The product is designed to protect ceiling openings that are made to accommodate recessed lighting fixtures in rated floor-ceiling construction. The product is placed over the light fixture on the top side of the ceiling, and rests on the ceiling membrane. The product is available in two sizes and is constructed with vent slots that can be used to accommodate power source cable.

<u>Attribute</u>	<u>Value</u>
Criteria	ASTM E119 (2012)
CSI Code	07 20 00 Thermal Protection
Intertek Services	Certification
Listed or Inspected	LISTED
Listing Section	OTHER PRODUCTS
Report Number	16683-1, 16683-115827
Spec ID	29353

# DRAWING INDEX

TEN/FCA 60-01/OPL LC 101


# TEN/FCA 60-01/OPL LC 101

Luminary Covers

Design No. LC 101

LUMINARY COVERS

F-Rating - 1 hr

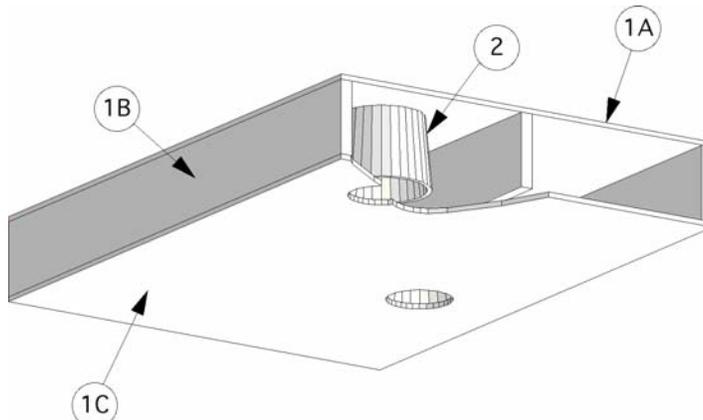

**1. FLOOR CEILING ASSEMBLY:**  
Constructed in the manner as specified below:

- A. Plywood subfloor: Min. 5/8 in. thick SYP plywood. Long dimension of panels, or face grain of plywood, to be perpendicular to joists (1B) with joints staggered. Plywood is secured to top side of joist assembly with min. No. 6, 1-7/8 in. long bugle-head drywall screws, spaced max. 16 in. OC. along joists.
- B. Lumber Joists: Parallel nom. 2 X 10, or deeper, lumber joists spaced a min. 16 in. o.c. and a max. of 24 in. OC.
- C. Gypsum Wallboard: Nom. 5/8 in. Type X gypsum wallboard is secured to the underside of the lumber joists (1B) with min. No. 6, 1-7/8 in. long bugle-head drywall screws, spaced max. 6 in. OC. along perimeter and on joists in the field. Apply vinyl or casein, dry or premixed joint compound to face layers of gypsum wallboard in two coats to all exposed fastener heads and gypsum wallboard joints. A min. 2 in. wide paper, plastic, or fiberglass tape is

embedded in first layer of compound over joints in gypsum wallboard.

**2. FIXTURE PROTECTION COVER:**

Constructed of a proprietary high-temperature fiber matrix and having an intumescent feature. Two sizes of covers are recognized within this Listing. The smaller cover has a base diameter of 14-1/2 in. and an overall height of 9 in. The larger cover has a base diameter of 17 in. and an overall height of 11-1/4 in. Covers are centered over openings up to 8 in. in diameter that are cut into the gypsum ceiling for the purpose of installing a recessed fixture. The cover may be slit to fit over obstructions in order to allow the cover to fit flush to the gypsum wallboard. When this occurs, caution is to be used to not damage the cover. The covers may be installed in the floor with the following provisions:

- Max. 1 opening within 16 sq. ft. area.
- Min. o.c. fixture spacing of 40 in. within same truss cavity.
- Min. center-to-center fixture spacing of 40 in. for adjacent truss cavities.

Revised March 5, 2004

© Omega Point Laboratories, Inc.

## TEN/FCA 60-01/OPL LC 101 (page 2 of 2)

### Luminary Covers

- A min. 1/4 in. gap space must be maintained between the top of the cover and the underside of the subfloor (1A).

**Listed Manufacturer:**

Tenmat, Ltd.

Fibrous Fiber Safing

FF109 Intumescent Fixture Protection  
Cover

3. RECESSED FIXTURE: (Not Shown)  
Installed in accordance with manufacturer's instructions. The fixture can be installed in an opening having a max. diameter of 8 in. The fixture must be secured to the framing of the floor, and may not be supported by the gypsum wallboard. Electrical wiring leading to and from the fixture may penetrate the cover. When this occurs, caution is to be used to not damage the cover, and the wiring is to fit snugly through any opening.